


Spring Flows, Reservoir Water and Treatment Plant Usage  
 2017 and 2018 Comparison  
 August 19th through Sept 17th

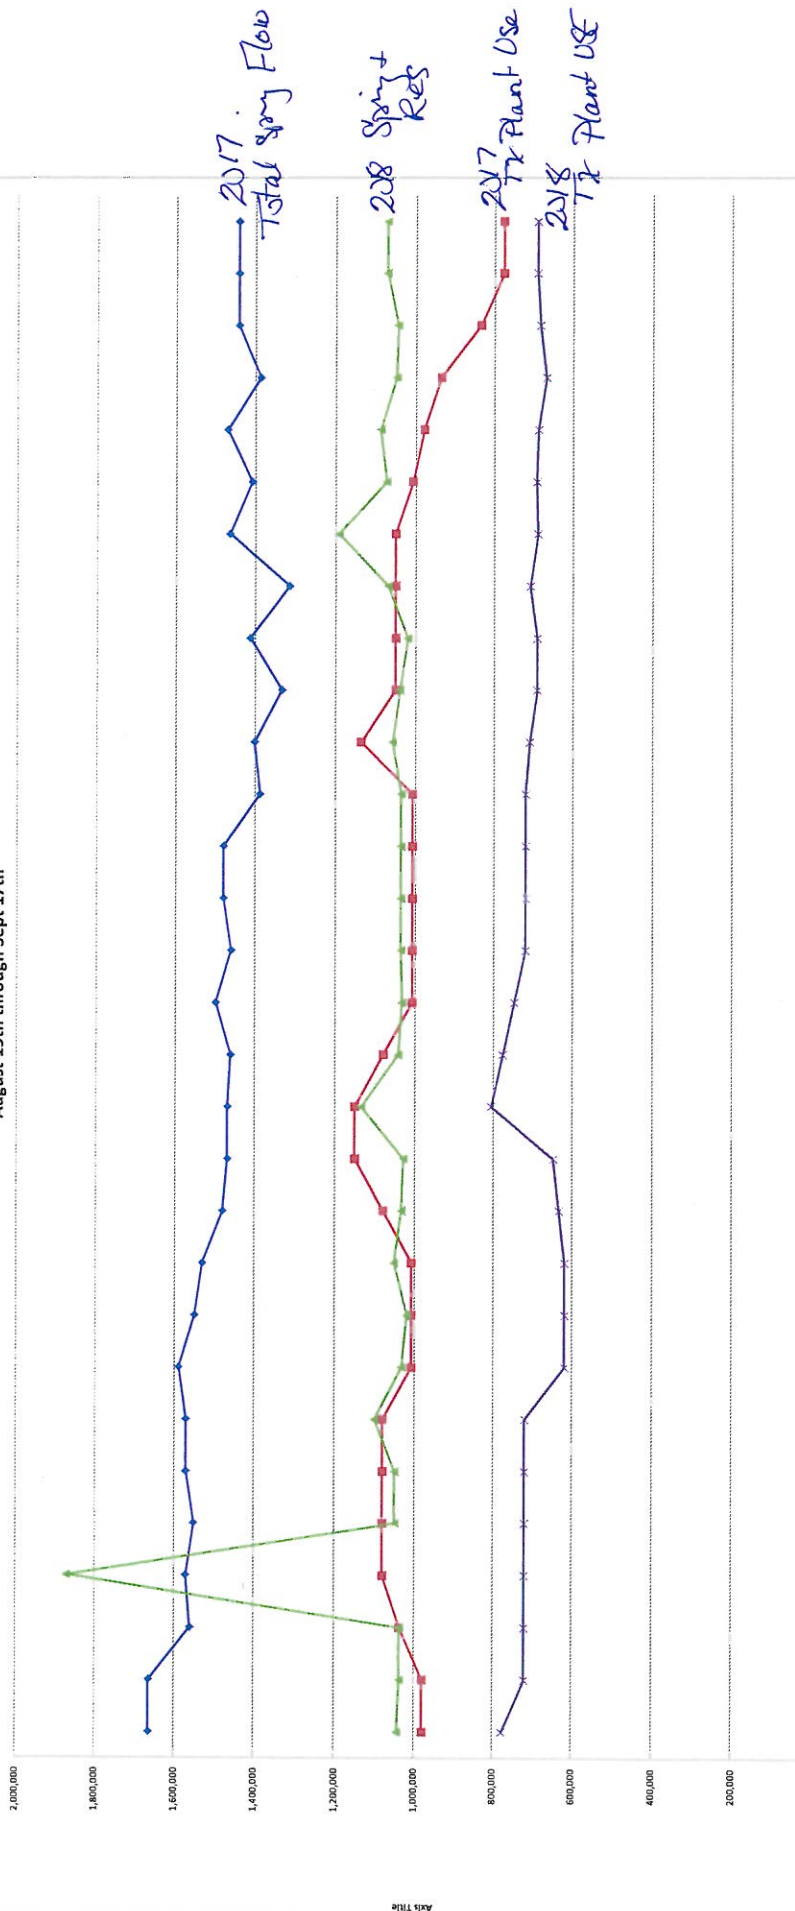

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	
2017 Total Spring Flow	1,664,248	1,664,248	1,560,280	1,571,167	1,551,779	1,571,167	1,771,117	1,590,645	1,550,465	1,531,480	1,480,686	1,466,673	1,458,673	1,461,300	1,495,167	1,460,390	1,479,779	1,479,779	1,389,300	1,405,573	1,335,560	1,413,112	1,316,172	1,464,814	1,408,689	1,470,367	1,388,390	1,440,696	1,443,260	1,443,260	
2017 Tx Plant Usage	979,200	979,200	1,036,800	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000	1,080,000
2018 Spring and Res. Flow	1,042,572	1,036,673	1,036,673	1,870,364	1,069,599	1,049,599	1,101,300	1,032,834	1,019,889	1,062,107	1,044,285	1,029,300	1,135,599	1,042,572	1,033,160	1,036,673	1,036,673	1,036,673	1,036,673	1,036,673	1,036,673	1,040,187	1,020,799	1,070,392	1,192,852	1,073,540	1,089,009	1,046,466	1,065,912	1,072,500	1,072,500
2018 Tx Plant Usage	777,600	770,000	720,000	720,000	710,000	720,000	720,000	619,200	619,200	619,200	633,600	648,000	806,400	777,600	788,800	720,000	720,000	720,000	720,000	709,970	691,200	691,200	708,480	689,760	692,640	688,320	668,160	684,000	691,200	691,200	691,200

Reservoir Water is being used to supplement treatment plant usage beginning in June 2018