


Spring Flows, Reservoir Water and Treatment Plant Usage
 2017 and 2018 Comparison
 August 25th through Sept 23rd

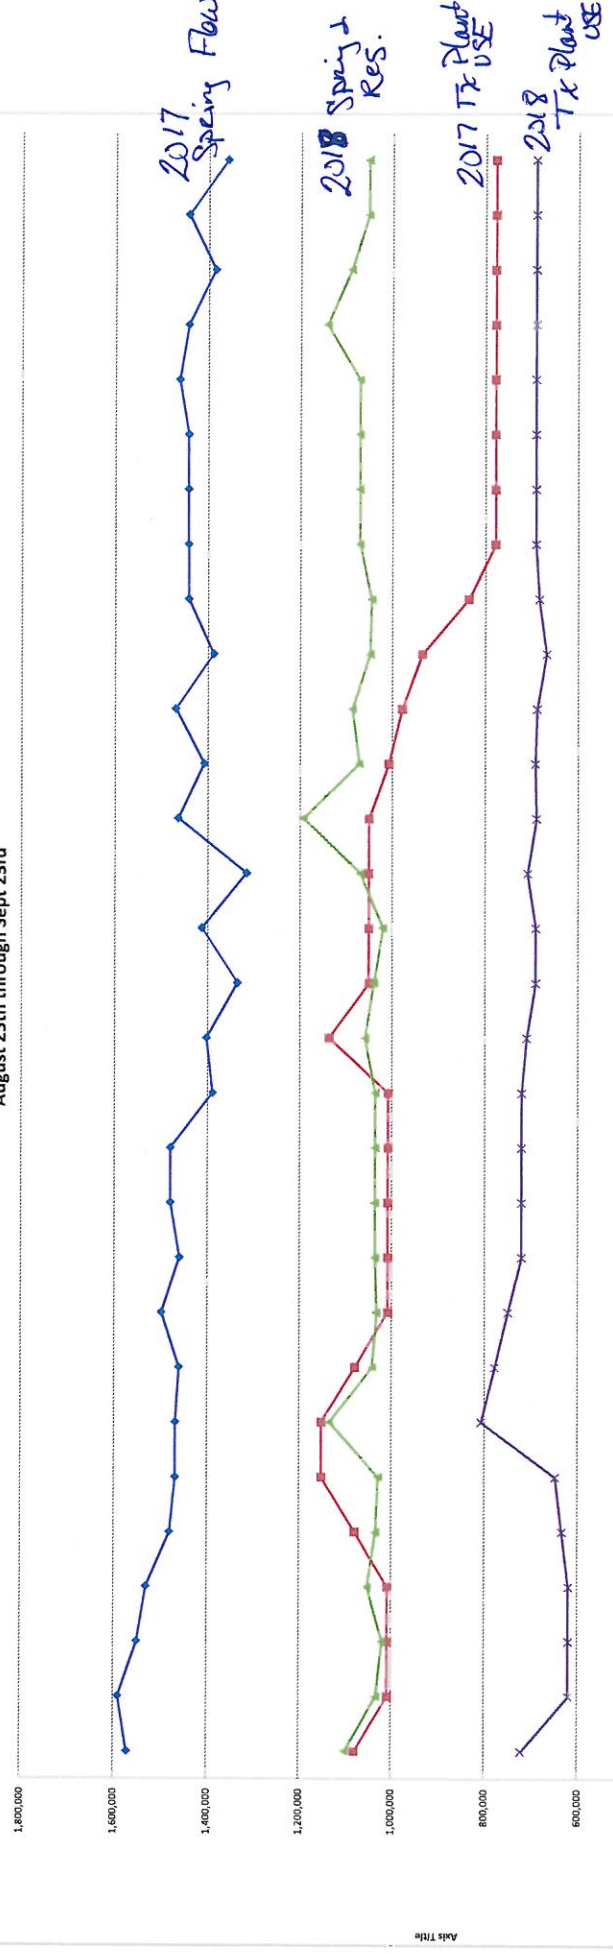

Day	2017 Total Spring Flows	2017 Tx Plant Use	2018 Spring and Res. Flow	2018 Tx Plant Use
1	1,571,167	1,589,645	1,550,865	1,551,480
2	1,080,000	1,098,800	1,098,800	1,098,000
3	1,109,300	1,072,414	1,072,414	1,072,414
4	1,109,300	1,072,414	1,072,414	1,072,414
5	1,109,300	1,072,414	1,072,414	1,072,414
6	1,109,300	1,072,414	1,072,414	1,072,414
7	1,109,300	1,072,414	1,072,414	1,072,414
8	1,109,300	1,072,414	1,072,414	1,072,414
9	1,109,300	1,072,414	1,072,414	1,072,414
10	1,109,300	1,072,414	1,072,414	1,072,414
11	1,109,300	1,072,414	1,072,414	1,072,414
12	1,109,300	1,072,414	1,072,414	1,072,414
13	1,109,300	1,072,414	1,072,414	1,072,414
14	1,109,300	1,072,414	1,072,414	1,072,414
15	1,109,300	1,072,414	1,072,414	1,072,414
16	1,109,300	1,072,414	1,072,414	1,072,414
17	1,109,300	1,072,414	1,072,414	1,072,414
18	1,109,300	1,072,414	1,072,414	1,072,414
19	1,109,300	1,072,414	1,072,414	1,072,414
20	1,109,300	1,072,414	1,072,414	1,072,414
21	1,109,300	1,072,414	1,072,414	1,072,414
22	1,109,300	1,072,414	1,072,414	1,072,414
23	1,109,300	1,072,414	1,072,414	1,072,414
24	1,109,300	1,072,414	1,072,414	1,072,414
25	1,109,300	1,072,414	1,072,414	1,072,414
26	1,109,300	1,072,414	1,072,414	1,072,414
27	1,109,300	1,072,414	1,072,414	1,072,414
28	1,109,300	1,072,414	1,072,414	1,072,414
29	1,109,300	1,072,414	1,072,414	1,072,414
30	1,109,300	1,072,414	1,072,414	1,072,414

Reservoir Water is being used to supplement treatment plant usage beginning in June 2018