



Spring Flows, Reservoir Water and Treatment Plant Usage  
 2017 and 2018 Comparison  
 September 1st through September 30th

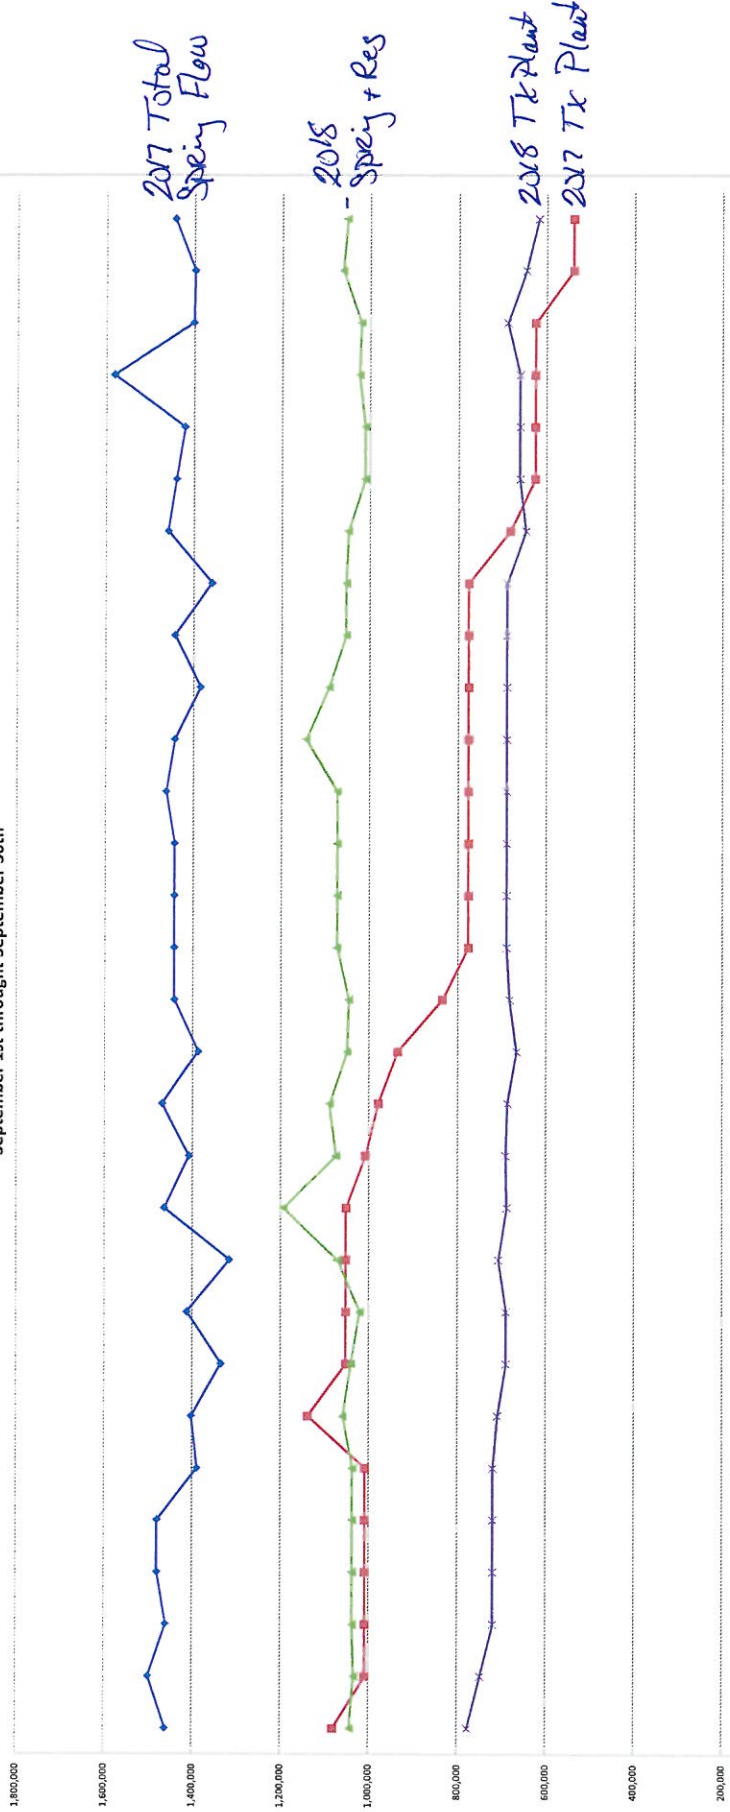

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30
2017 Total Spring Flow	1,461,810	1,459,117	1,460,390	1,479,779	1,479,779	1,389,300	1,407,571	1,395,560	1,431,117	1,316,117	1,464,934	1,408,889	1,701,867	1,386,390	1,442,896	1,443,260	1,443,260	1,443,260	1,462,648	1,441,560	1,385,096	1,443,260	1,359,242	1,459,224	1,440,708	1,421,315	1,587,983	1,401,974	1,391,542	1,444,781
2017 Tx Plant Usage	1,080,000	1,068,000	1,068,000	1,068,000	1,068,000	1,068,000	1,137,600	1,051,200	1,051,200	1,051,200	1,051,200	1,068,000	979,200	936,000	832,200	777,600	777,600	777,600	777,600	777,600	77,600	777,600	777,600	777,600	684,000	626,400	626,400	626,400	540,000	
2018 Spring and Res. Flow	1,042,217	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140	1,031,140
2018 Tx Plant Usage	77,600	74,880	72,000	72,000	72,000	72,000	70,720	70,720	69,120	69,120	68,840	68,840	68,840	68,320	66,160	64,000	61,200	61,200	61,200	61,200	61,200	61,200	61,200	61,200	61,200	62,000	62,400	61,200	61,200	61,200

Reservoir water is being used to supplement treatment plant usage beginning in June 2018

Spring Flows, Reservoir Water and Treatment Plant Usage  
 2017 and 2018 Comparison  
 September 8th through October 7th

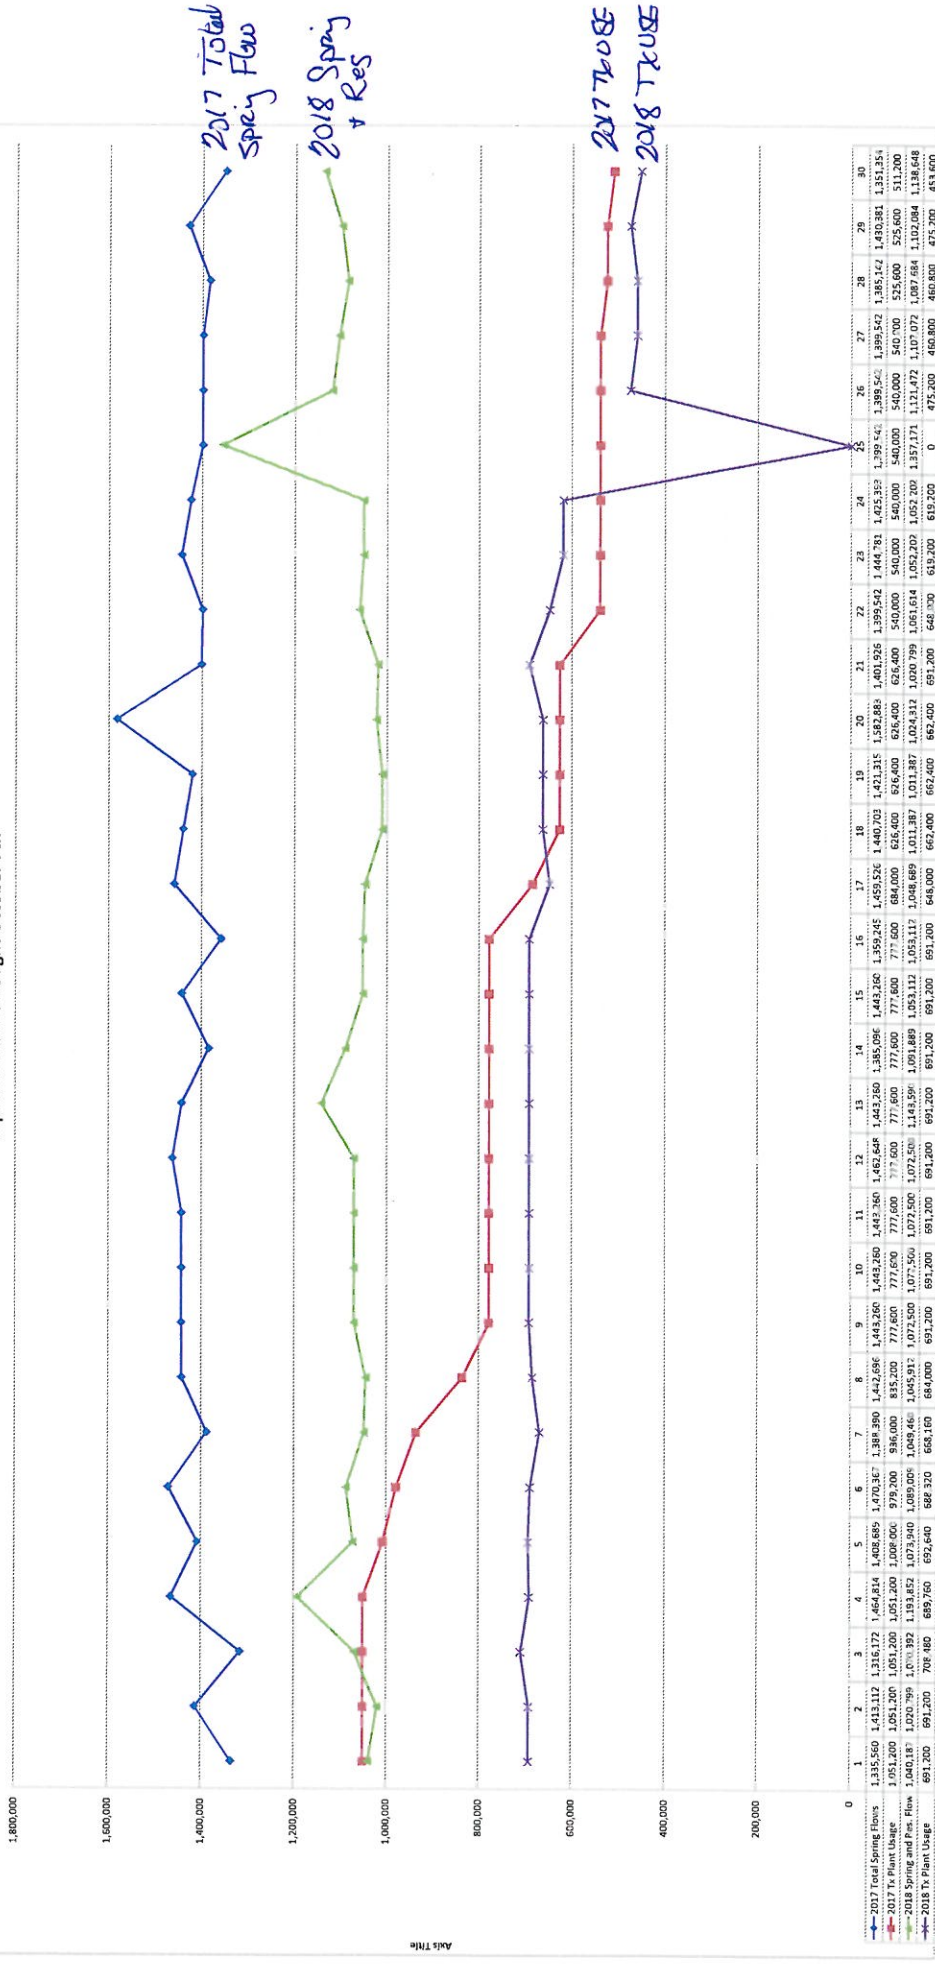

Reservoir Water is being used to supplement treatment plant usage beginning in June 2018